

107-14-HL-LS

Non-Recessed, High/Low Drinking Fountain With Cane Apron



Fountain bowl, cane apron, cover plate and optional access panel shown in standard #4 stainless steel satin finish with "Soft Touch" valves and bubblers in mirror finish

Dimensions in drawing subject to options selected.

Features

- [2] 14" diameter, 16 ga. fountain bowls
- No plastic parts
- 100% made in the USA
- · Manufactured with lead-free materials
- Integral drain in bowl for ease of cleaning
- ½" steel support arm and wall bracket capable of supporting 500 lbs.
- Matching cover plate, finishes including unlimited powder coat colors
- Options include vandal proof bubblers, bottle fillers, sensor activation, bottle counters, finishes, bubbler valves, and more

Recommended Add-ons


Chiller

Equip your fountain with a Filtrine point-ofuse or remote chiller to cool your drinking water. We can help you select the most economical chiller model to fit your demand.

Purifier


Ensure that your drinking water is of the highest quality by adding a Filtrine Taste Master* purifier cabinet underneath the fountain or a remote purification system serving all fountains in the building.

Top View




Select Low Fountain Location ☐ Left [S] ☐ Right

Side View




Front View

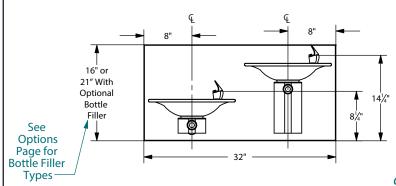

For options, finishes and more see page 2


Filtrine Mfg. Co. • 15 Kit St. Keene, NH 03431 USA 800-930-3367 • 603-352-5500 • FAX (603) 352-0330 www.filtrine.com • drinkingwater@filtrine.com








107-14-HL-LS [EB] REVISED 03/14/2018

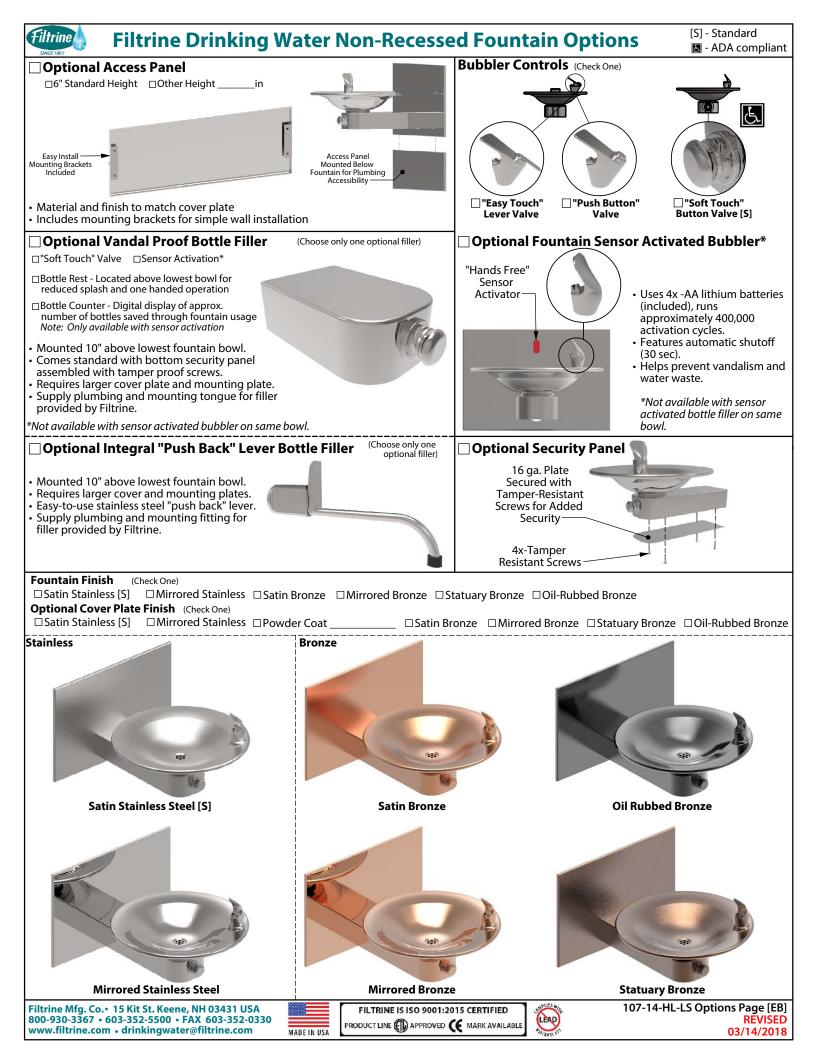



Model 107-14-HL-LS Drinking Water Installation Drawing

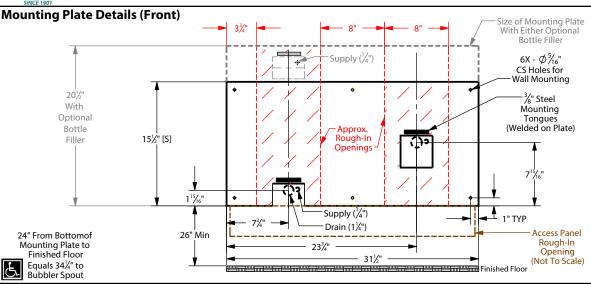

Approximate Rough-In Dimensions

Model	Height	Width
Standard Plate	15½"	8"
Bottle Filler Plate	20½"	8"

Approximate Access Panel Rough-In Dimensions (outlined, left)

Model	Height	Width
Standard Panel	5½"*	30½"


*If height specified, rough-in height will be 1/2" less than specified height

All views shown are for typical installation of 107-14-HL-LS. Views, dimensions and diagrams may change for specific installation requirements.


Exploded On-Wall Installation View 107-14-HL-LS with Access Panel


Typical Assembly Instructions (Always Install Per Local Code)

- 1. Cut rough opening as shown above and install blocking or fixture carrier as required to support the assembly.
- If optional access panel was ordered cut a separate rough opening (table, top right) extending below the fountain mounting plate.
- 3. Run drain piping to center of openings on mounting plate, and install drain traps in wall per local code.
- 4. Run supply water lines with service valve, if necessary.
- 5. If optional bottle filler is included with order, attach piping assembly provided by Filtrine to the back side of the mounting plate with two screws and rubber gasket for standard bottle filler and flare connection for vandal proof bottle filler.
- 6. Fasten mounting plate over rough opening with ¹/₁₆" countersunk lag bolts with bottom of plate 26" above the floor to meet ADA fountain height requirement of 34½" to the bubbler spout.
- 7. Install cover plate over the mounting plate for on-wall installations.
- Slide each fountain and vandal proof bottle filler arm (if ordered) over the horizontal tongues protruding from the mounting plate and fasten arms with set screws pushing slightly against the cover plate or finished wall.
- Connect drain plumbing to slip coupling and connect water supply connections.
- 10. If your model includes the access panel, measure, mark and install the included "L" brackets with #8-32 screws and align panel to cover plate with alignment pins.

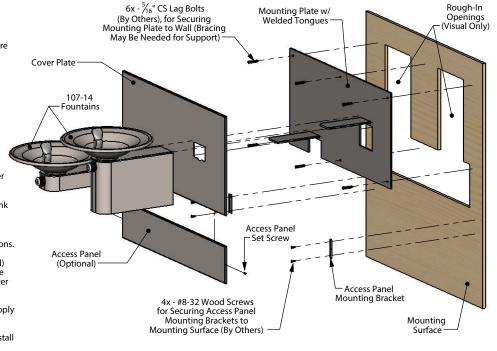


Access Panel Mounting Brackets Installation Details





Typical Drain Plumbing Detail (In-Wall Plumbing Provided By Others, Install Per Local Code)

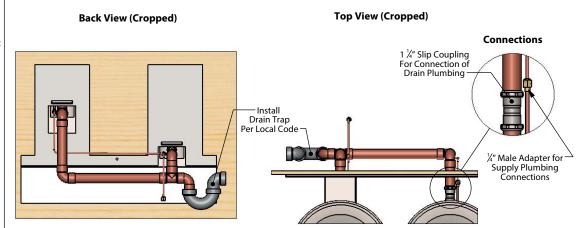

Filtrine Mfg. Co. • 15 Kit St. Keene, NH 03431 USA 800-930-3367 • 603 352-5500 • FAX (603) 352-0330 www.filtrine.com • drinkingwater@filtrine.com







107-14-HL-LS Installation Drawing [EB] REVISED 03/14/2018